


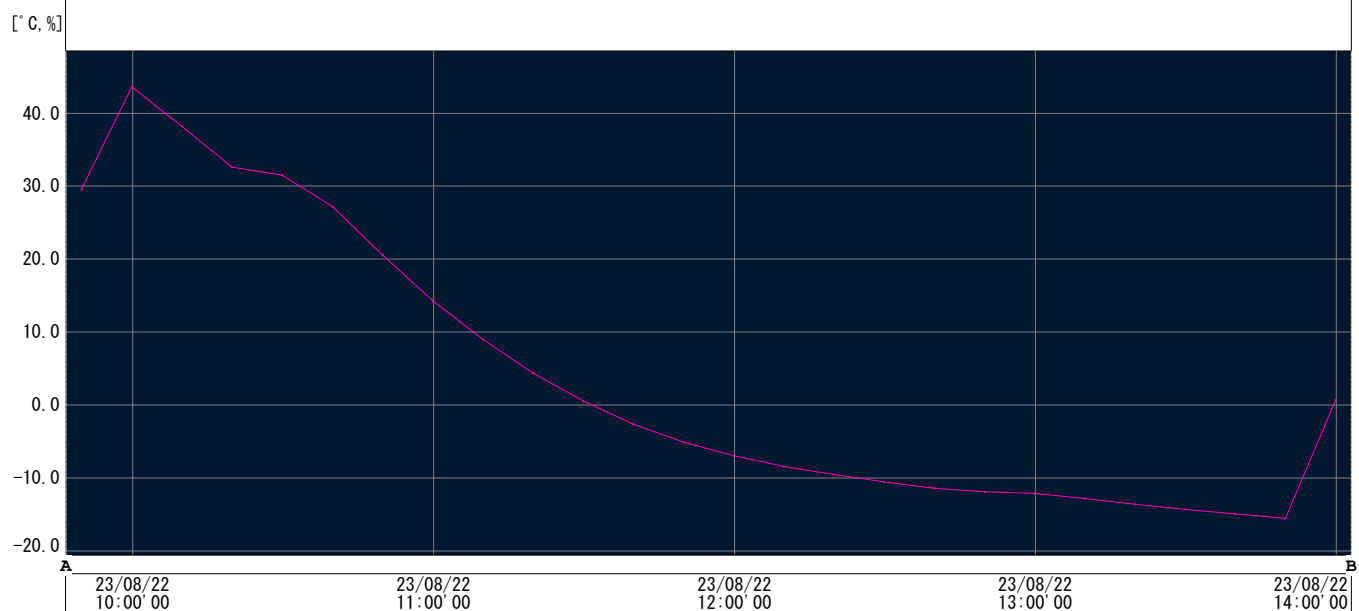

ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	26	-----	-----	-----	43.6	-15.5	4.0	°C
	Cur. A Date :	2023/08/22	9:46' 39							
	Cur. B Date :	2023/08/22	14:03' 00							
	diff. A-B :	0day 04:16' 21								
			Data Range	2023/08/22	9:46' 39-2023/08/22	14:03' 00				
			Calc. Range	2023/08/22	9:49' 39-2023/08/22	14:00' 00				