


温度・湿度グラフ

2024/03/18 13:25'14

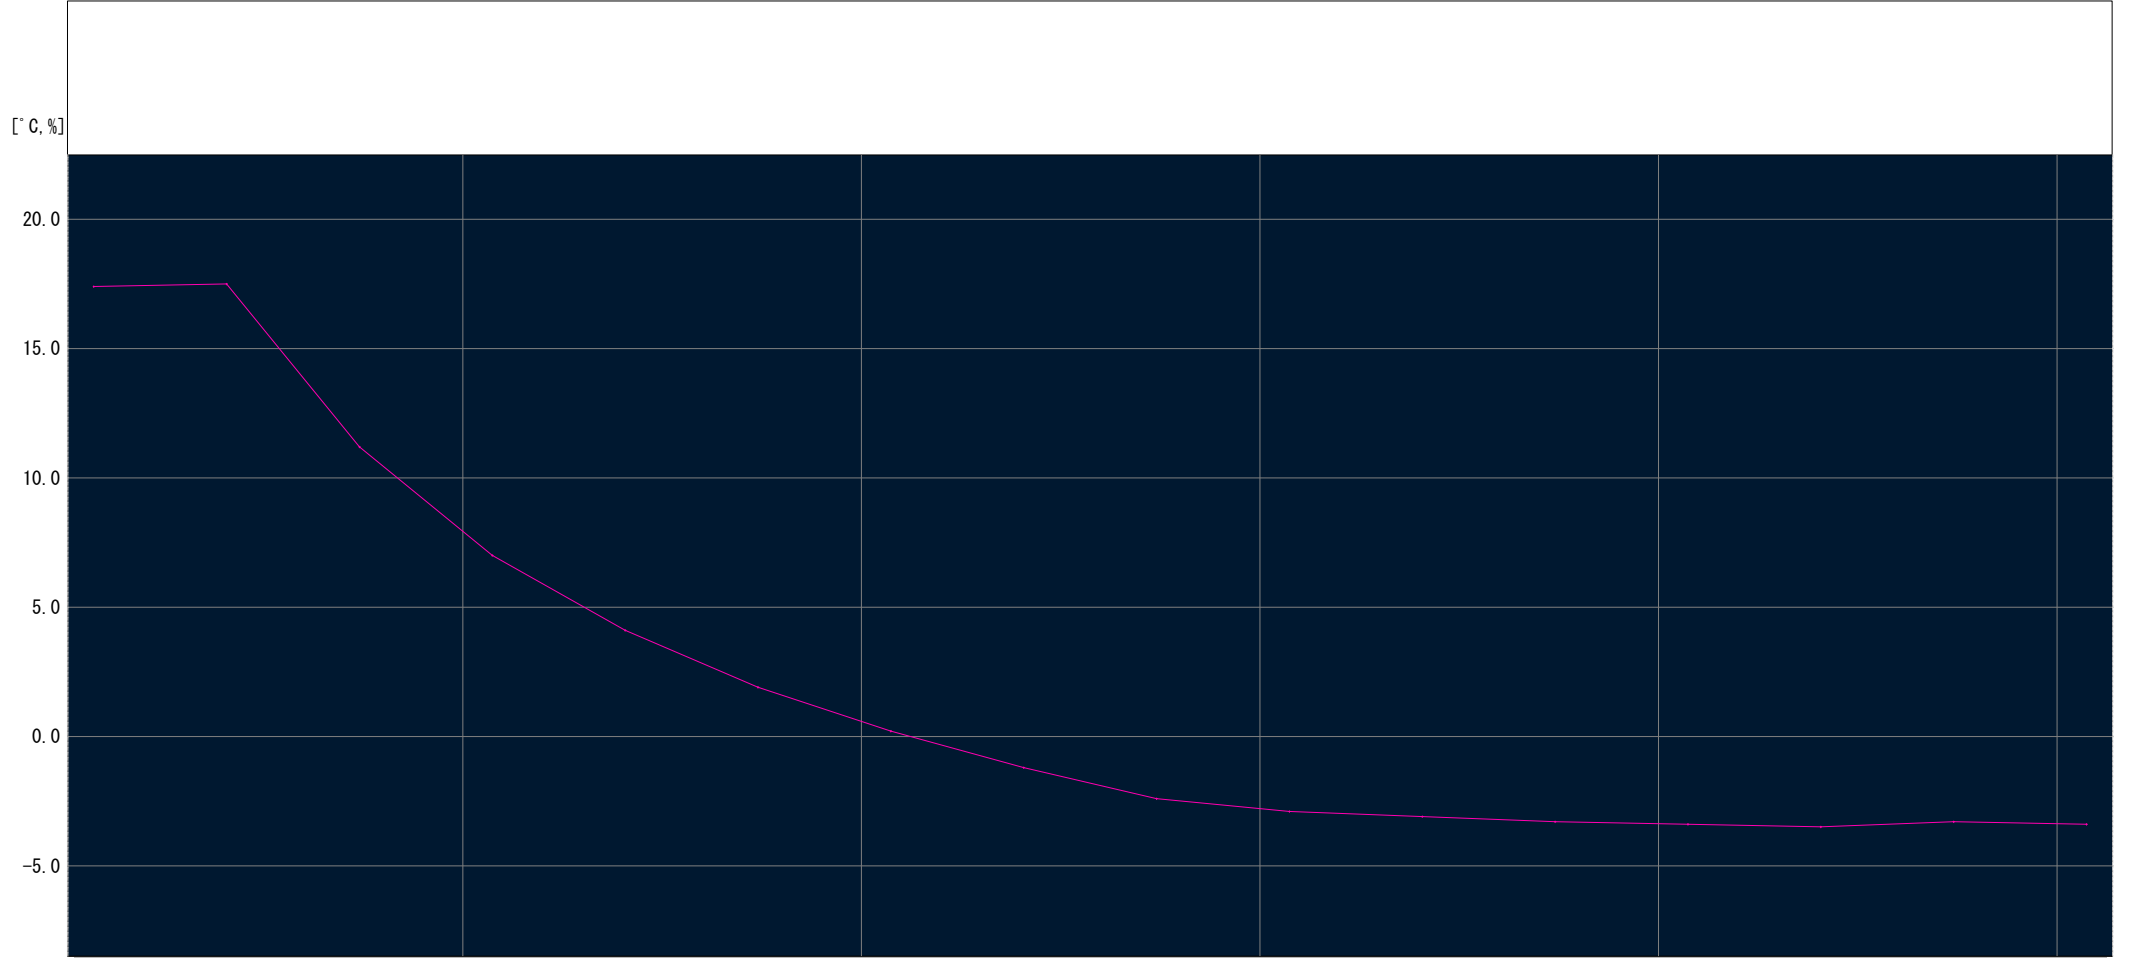

A 24/03/18 11:11'00 24/03/18 11:41'00 24/03/18 12:11'00 24/03/18 12:41'00 24/03/18 13:11'00 B

ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	16	-----	-----	-----	17.5	-3.5	2.1	°C
Cur. A Date : 2024/03/18 10:41'15							Data Range 2024/03/18 10:41'15-2024/03/18 13:15'12			
Cur. B Date : 2024/03/18 13:15'12							Calc. Range 2024/03/18 10:43'03-2024/03/18 13:13'24			
diff. A-B : Oday 02:33'57										