


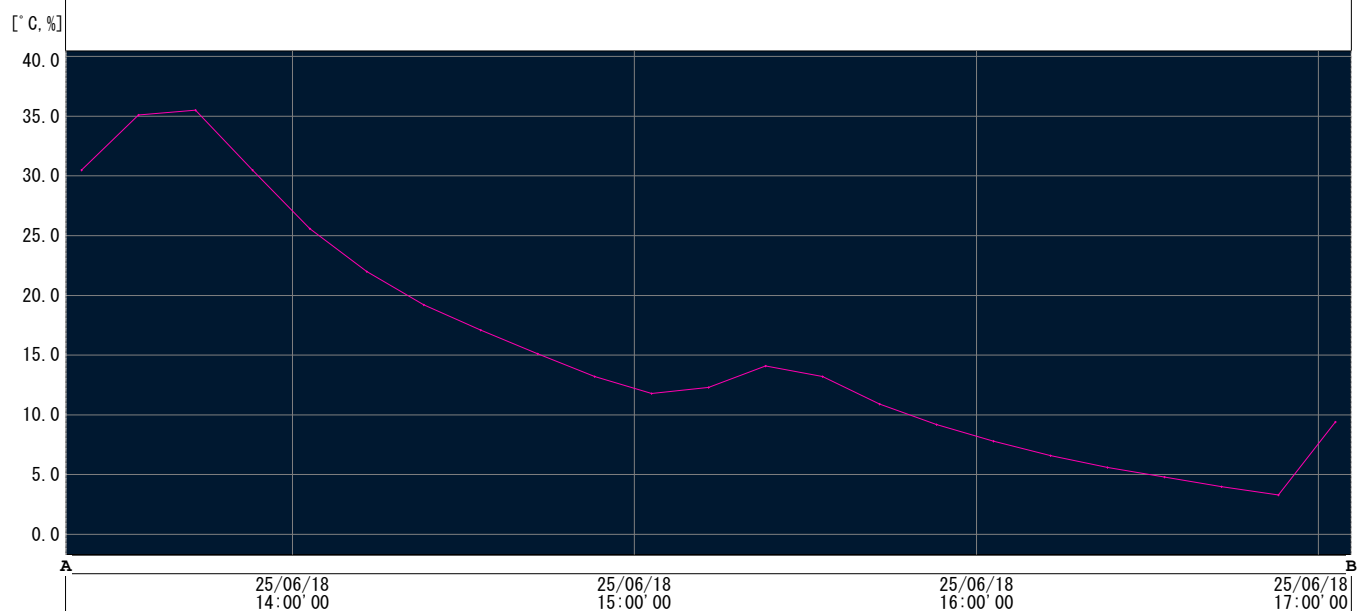

ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	23	-----	-----	-----	35.5	3.3	15.5	°C
	Cur. A Date :	2025/06/18 13:20' 12								
	Cur. B Date :	2025/06/18 17:05' 49								
	diff. A-B :	Oday 03:45' 37								
			Data Range	2025/06/18 13:20' 12-2025/06/18 17:05' 49						
			Calc. Range	2025/06/18 13:22' 50-2025/06/18 17:03' 11						