


温度・湿度グラフ

2025/06/21 13:43'37

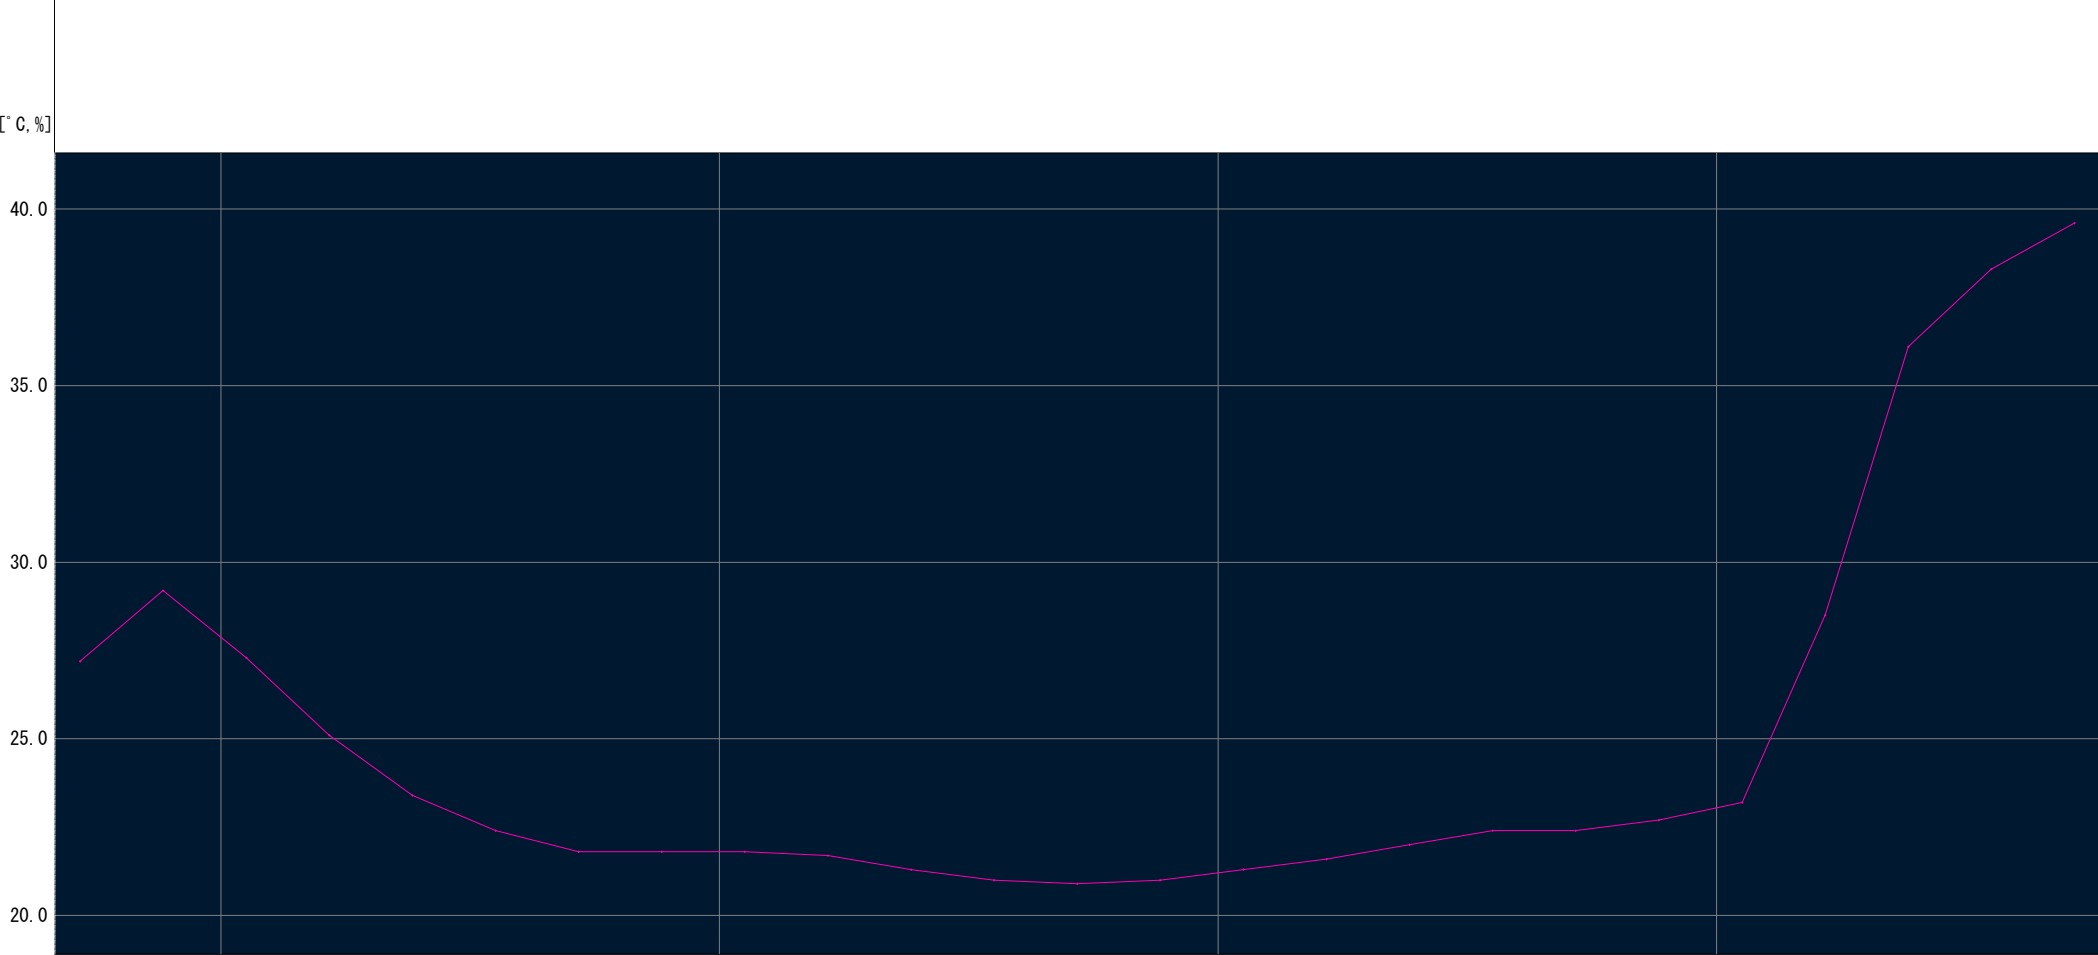

25/06/21 10:00'00		25/06/21 11:00'00		25/06/21 12:00'00		25/06/21 13:00'00				
ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	25	-----	-----	-----	39.6	20.9	25.0	°C
Cur. A Date : 2025/06/21 9:40'00						Data Range 2025/06/21 9:40'00-2025/06/21 13:46'07				
Cur. B Date : 2025/06/21 13:46'07						Calc. Range 2025/06/21 9:42'53-2025/06/21 13:43'14				
diff. A-B : 0day 04:06'07										