


温度・湿度グラフ

2026/01/27 14:02' 59

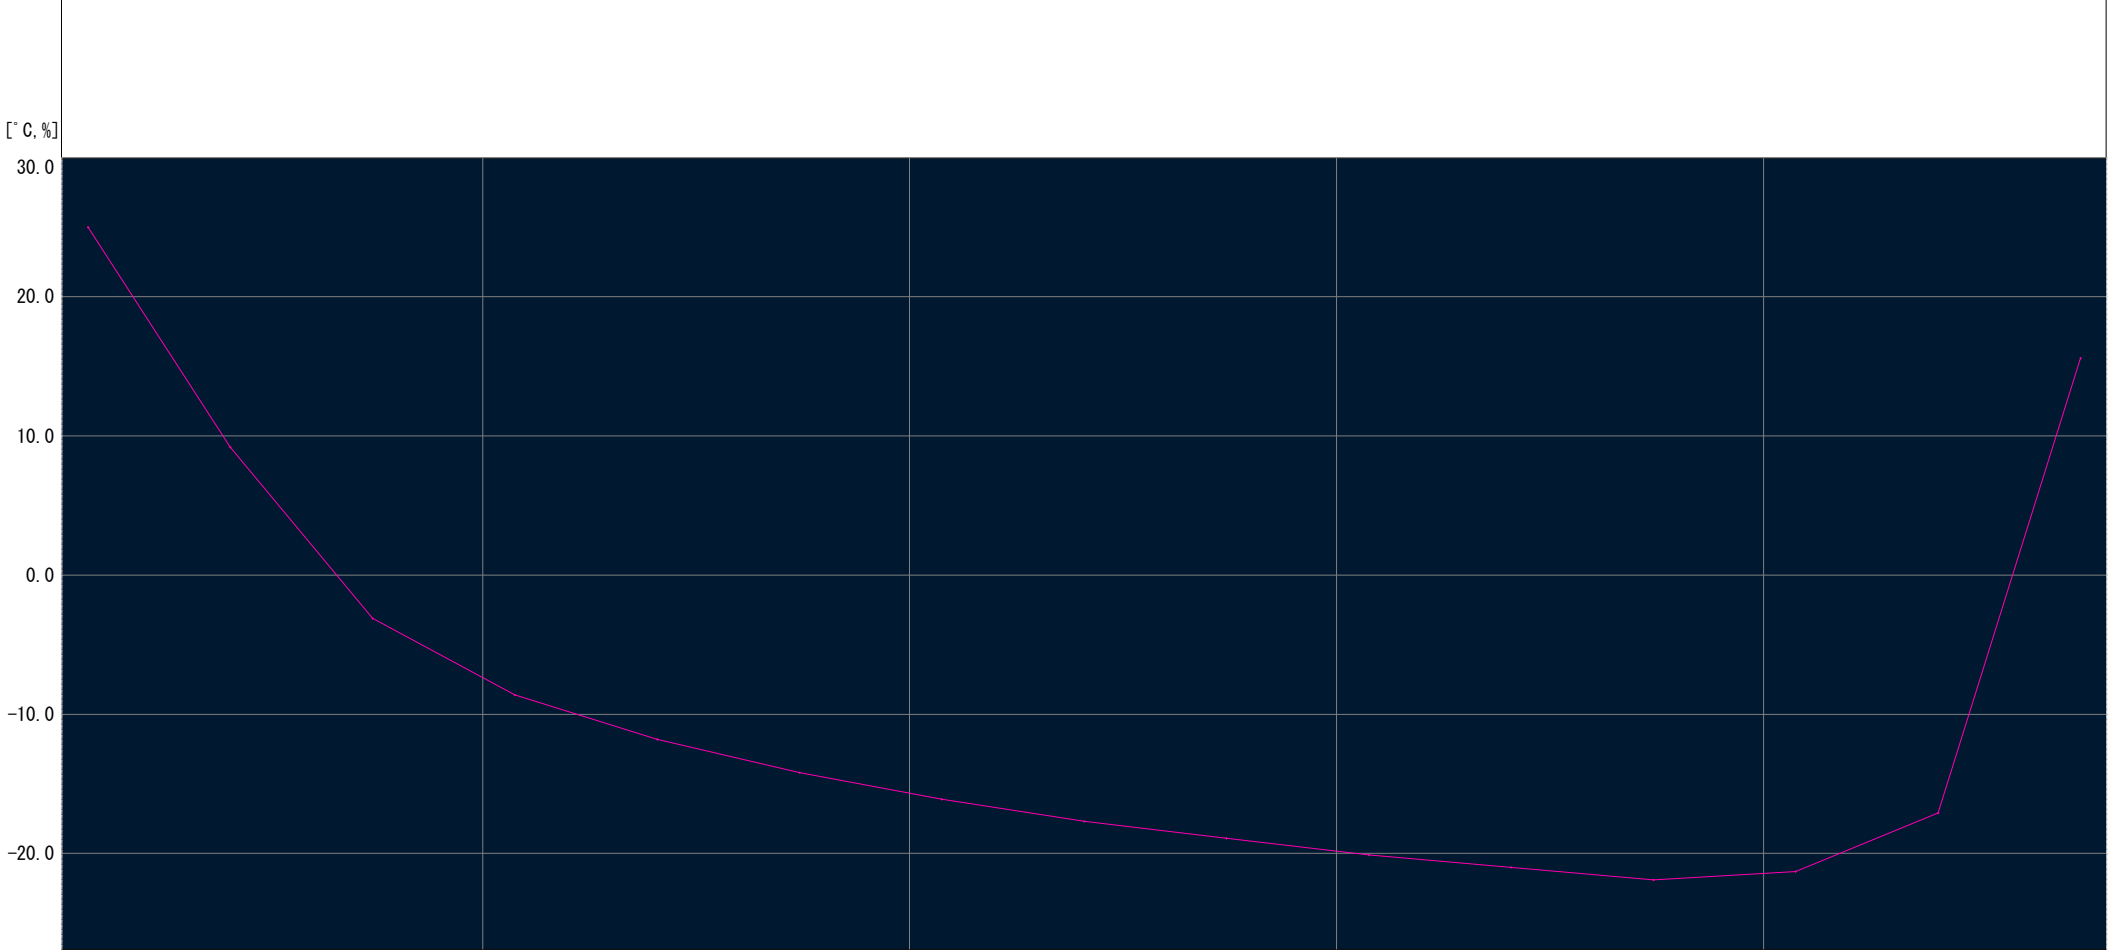

A		26/01/27 12:09' 00	26/01/27 12:39' 00	26/01/27 13:09' 00	26/01/27 13:39' 00	B				
ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	15	-----	-----	-----	25.0	-21.9	-9.5	°C
Cur. A Date : 2026/01/27 11:39' 25							Data Range 2026/01/27 11:39' 25-2026/01/27 14:03' 08			
Cur. B Date : 2026/01/27 14:03' 08							Calc. Range 2026/01/27 11:41' 06-2026/01/27 14:01' 27			
diff. A-B : Oday 02:23' 43										